


GENERAL NOTES:

1. ELECTRICAL CONTRACTOR SHALL COORDINATE EXACT LOCATION OF ALL MECHANICAL UNITS WITH MECHANICAL CONTRACTOR.
2. ALL EXPOSED CONDUIT SHALL BE ROUTED PERPENDICULAR, PARALLEL, AND TIGHT TO COLUMNS AND BEAMS. ALL EXPOSED CONDUIT ROUTING SHALL BE COORDINATED WITH ENGINEER AND ARCHITECT PRIOR TO INSTALLATION. NO ADDITIONAL COST TO OWNER WILL BE ALLOWED FOR RELOCATING CONDUIT DUE TO THE LACK OF COORDINATION WITH ARCHITECT.
3. ALL BACK BOXES SHALL BE FLUSH MOUNTED UNLESS NOTED OTHERWISE. ALL VERTICAL SECTIONS OF CONDUIT SHALL BE CONCEALED. CONTRACTOR SHALL COORDINATE INSTALLATION OF CONDUIT AND BACK BOXES IN CONCRETE, MASONRY AND GYP. WALLS.
4. CIRCUITS TO ALL MECHANICAL EQUIPMENT SHALL BE DEDICATED UNLESS NOTED OTHERWISE.
5. ALL 277V LIGHTING CIRCUITS TERMINATING AT LIGHTING CONTROL PANELS SHALL HAVE A MINIMUM LENGTH OF 50 FEET BETWEEN LIGHTING CONTROL PANEL AND BRANCH LIGHTING PANEL.
6. ALL UNDERGROUND MEDIUM VOLTAGE CONDUITS SHALL BE 5" UNLESS OTHERWISE NOTED.

KEYNOTES:

- 13 REFER TO ARCHITECTURAL ELEVATIONS FOR TV POWER LOCATION
- 36 PROVIDE CONNECTION AS REQUIRED TO DETAIL KE6.0006.
- 82 PROVIDE CONNECTION TO LED PLAY CLOCK
- 124 PROVIDE HUBBELL 20A TWIST LOCK MODEL #HBL 2310SW.
- 125 DUPEX MOUNTED IN NFL ELECTRONIC CABINET.
- 150 PROVIDE HARD WIRED J-BOX CONNECTION TO GAME CLOCK MOUNTED AT 8' AFF. COORDINATE EXACT LOCATION WITH AV CONTRACTOR PRIOR TO INSTALL.

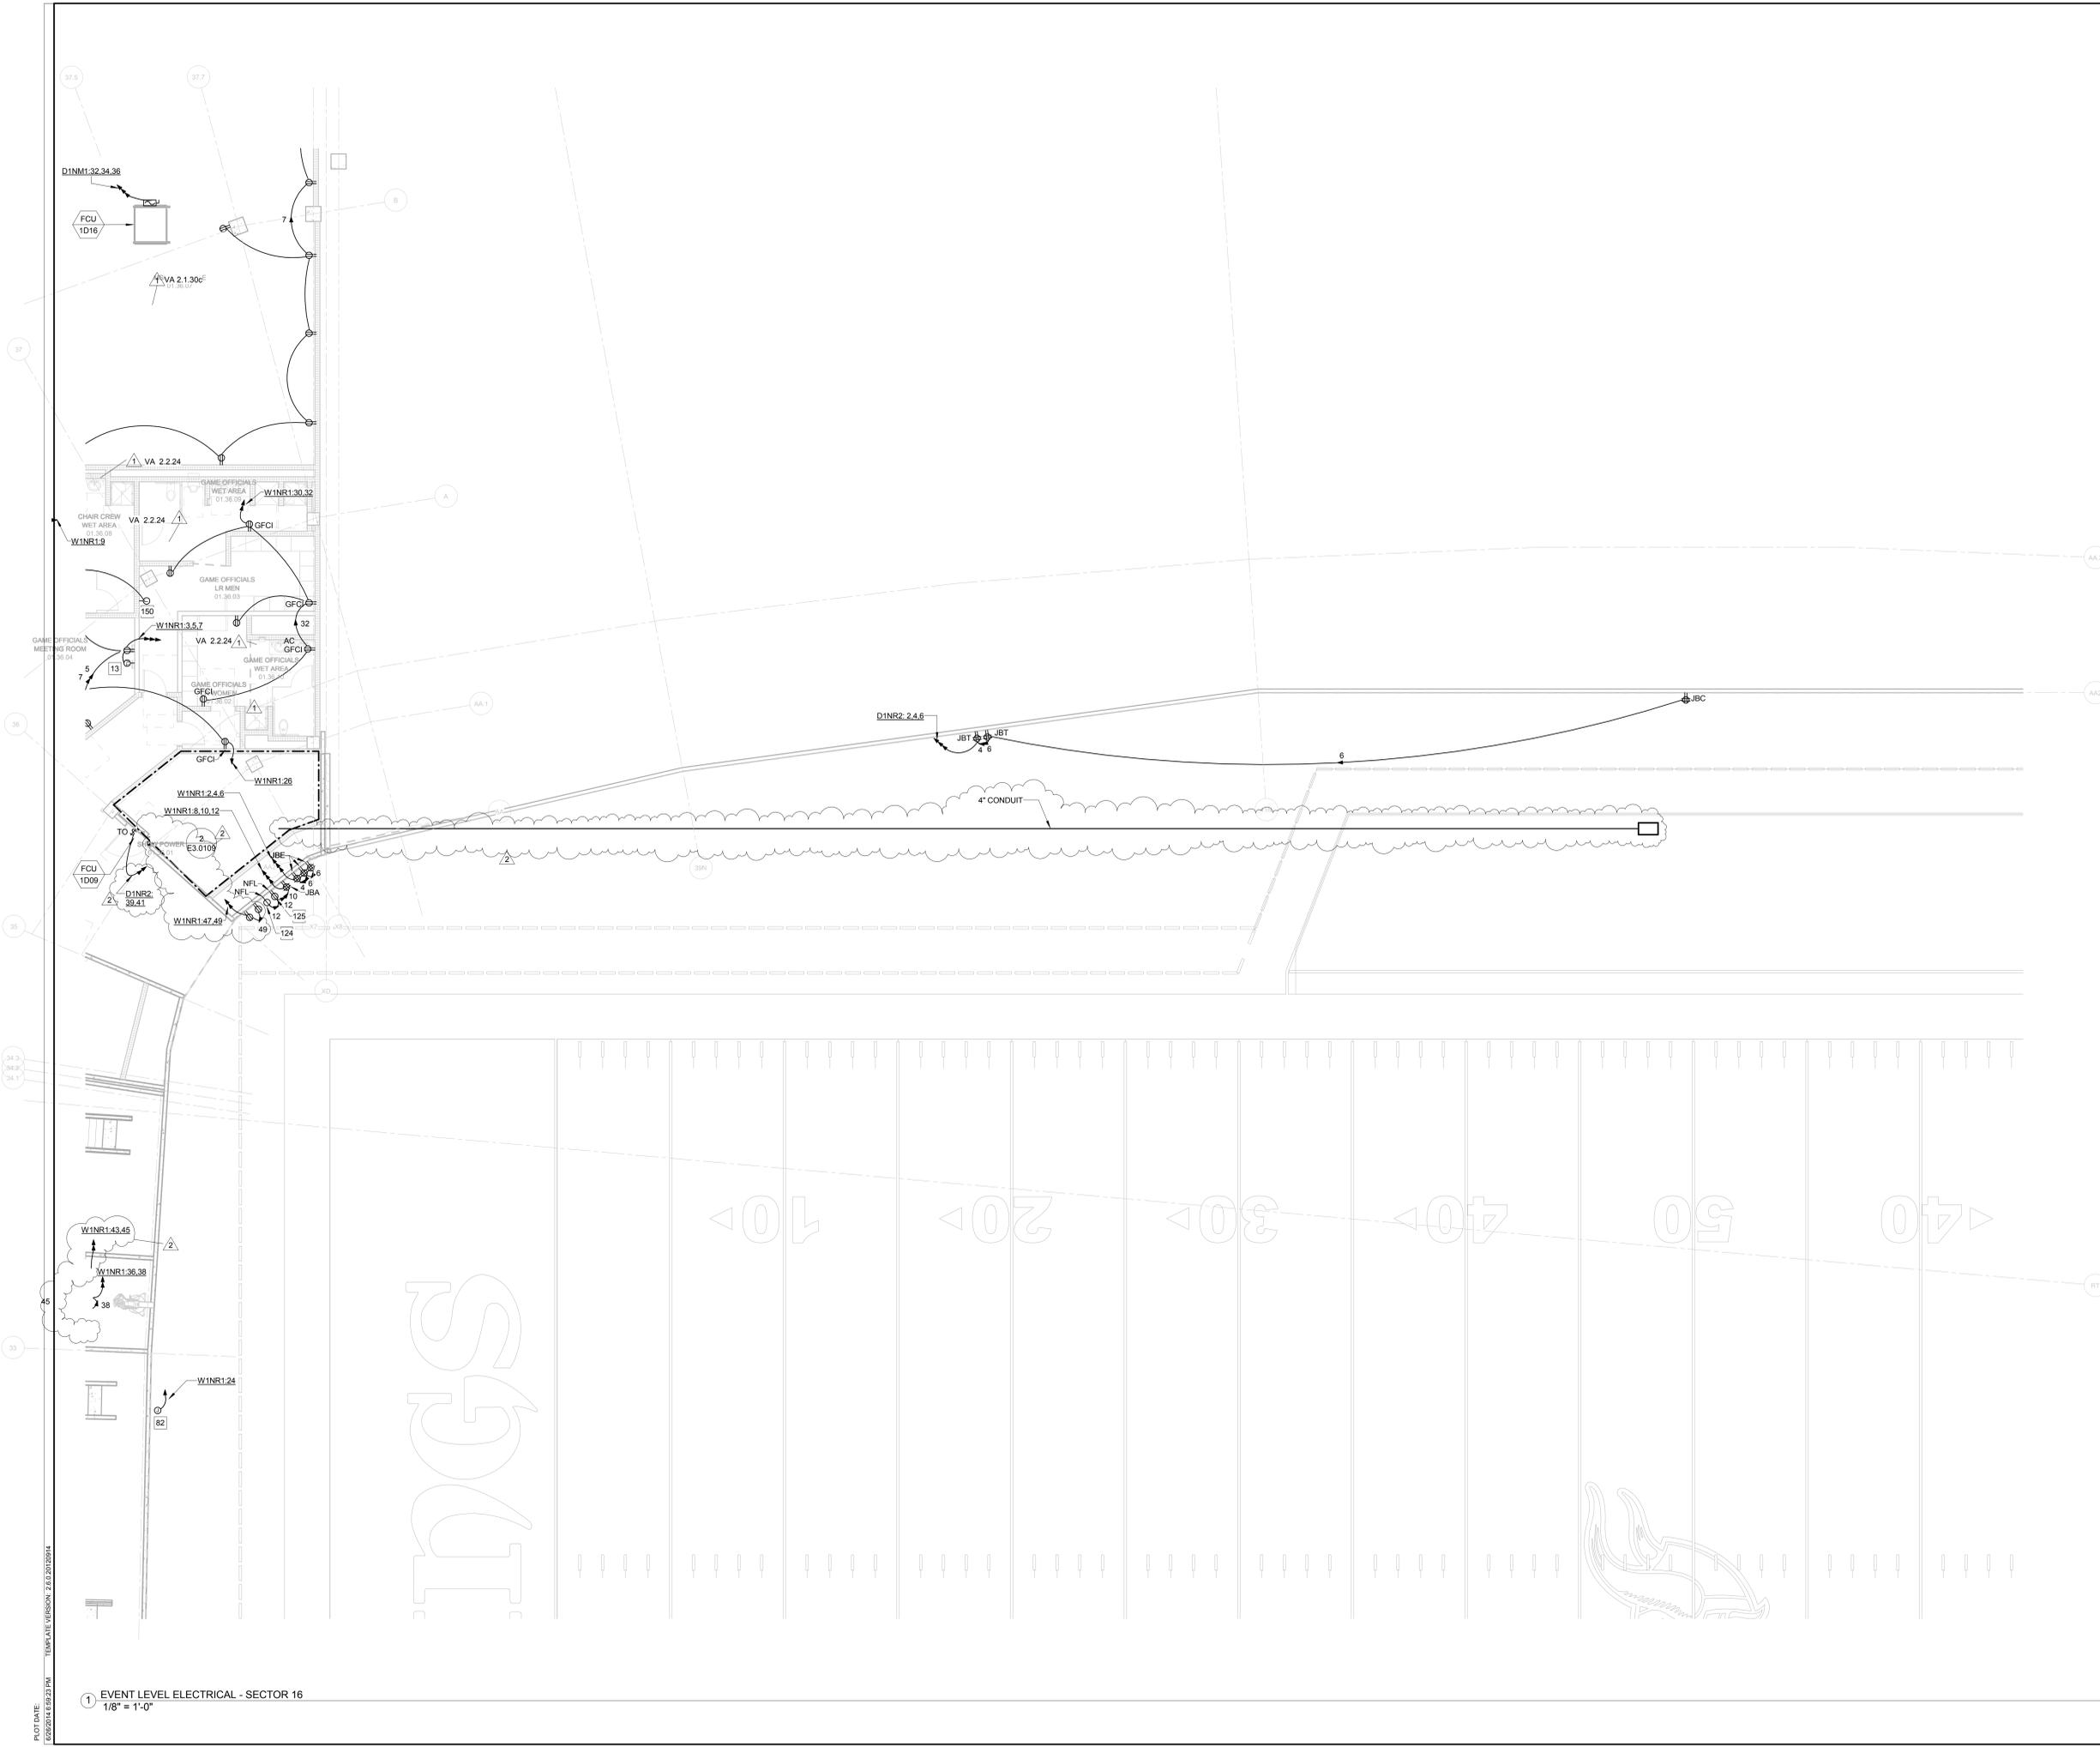

1 EVENT LEVEL ELECTRICAL - SECTOR 16
1/8" = 1'-0"

PROFESSIONAL ENGINEER
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Licensed Professional Engineer under the laws of the State of Minnesota.

Print Name: SCOTT V. GERARD
Signature: [Signature]
Date: 6/27/14 License #: 25884



REVISION NO.	DESCRIPTION	DATE
1	CCD-078	06/13/2014
2	CCD-088	06/27/2014

HKS PROJECT NUMBER
16246.000
DATE
MAY 2, 2014
ISSUE
CCD-060

SHEET TITLE
**ELECTRICAL LEVEL
ELECTRICAL POWER -
SECTOR 16**

SHEET NO.
E2.0116